

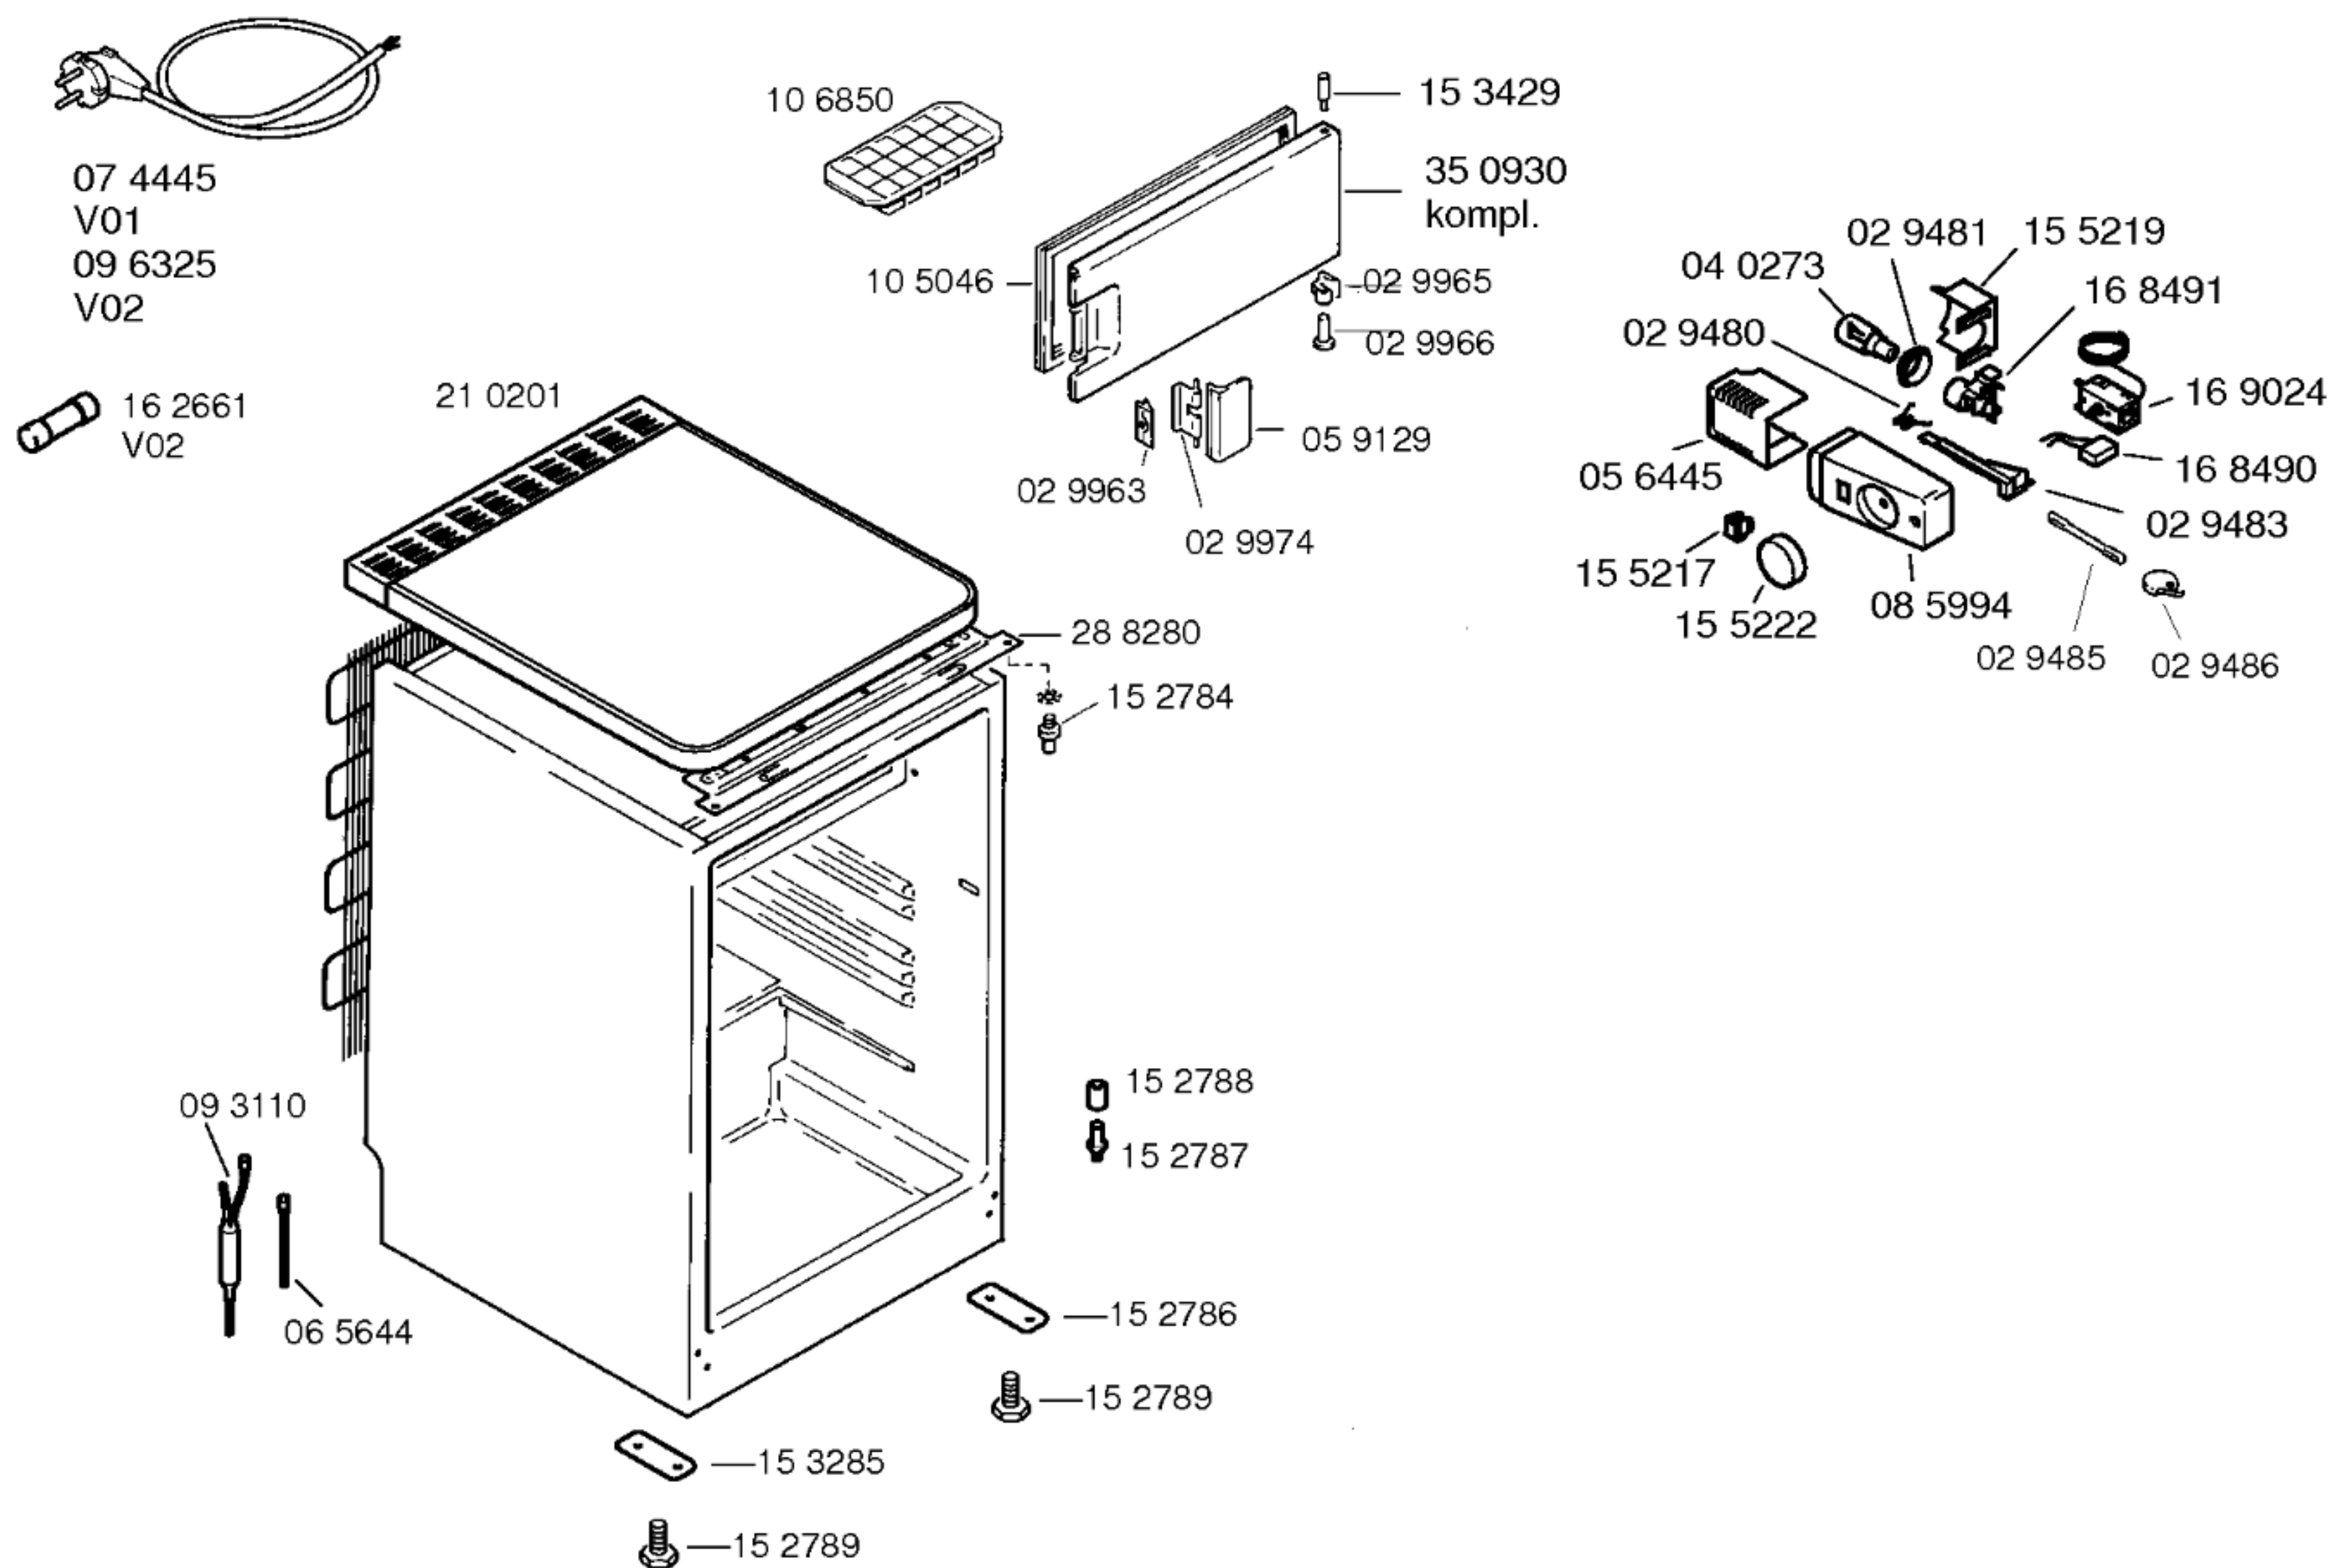


Ident – Nummern – Konstante	
3740	

Gebrauchsanweisung
51 3590
(D,GB,F,I,NL,S,SF,E,P,
DK,N)

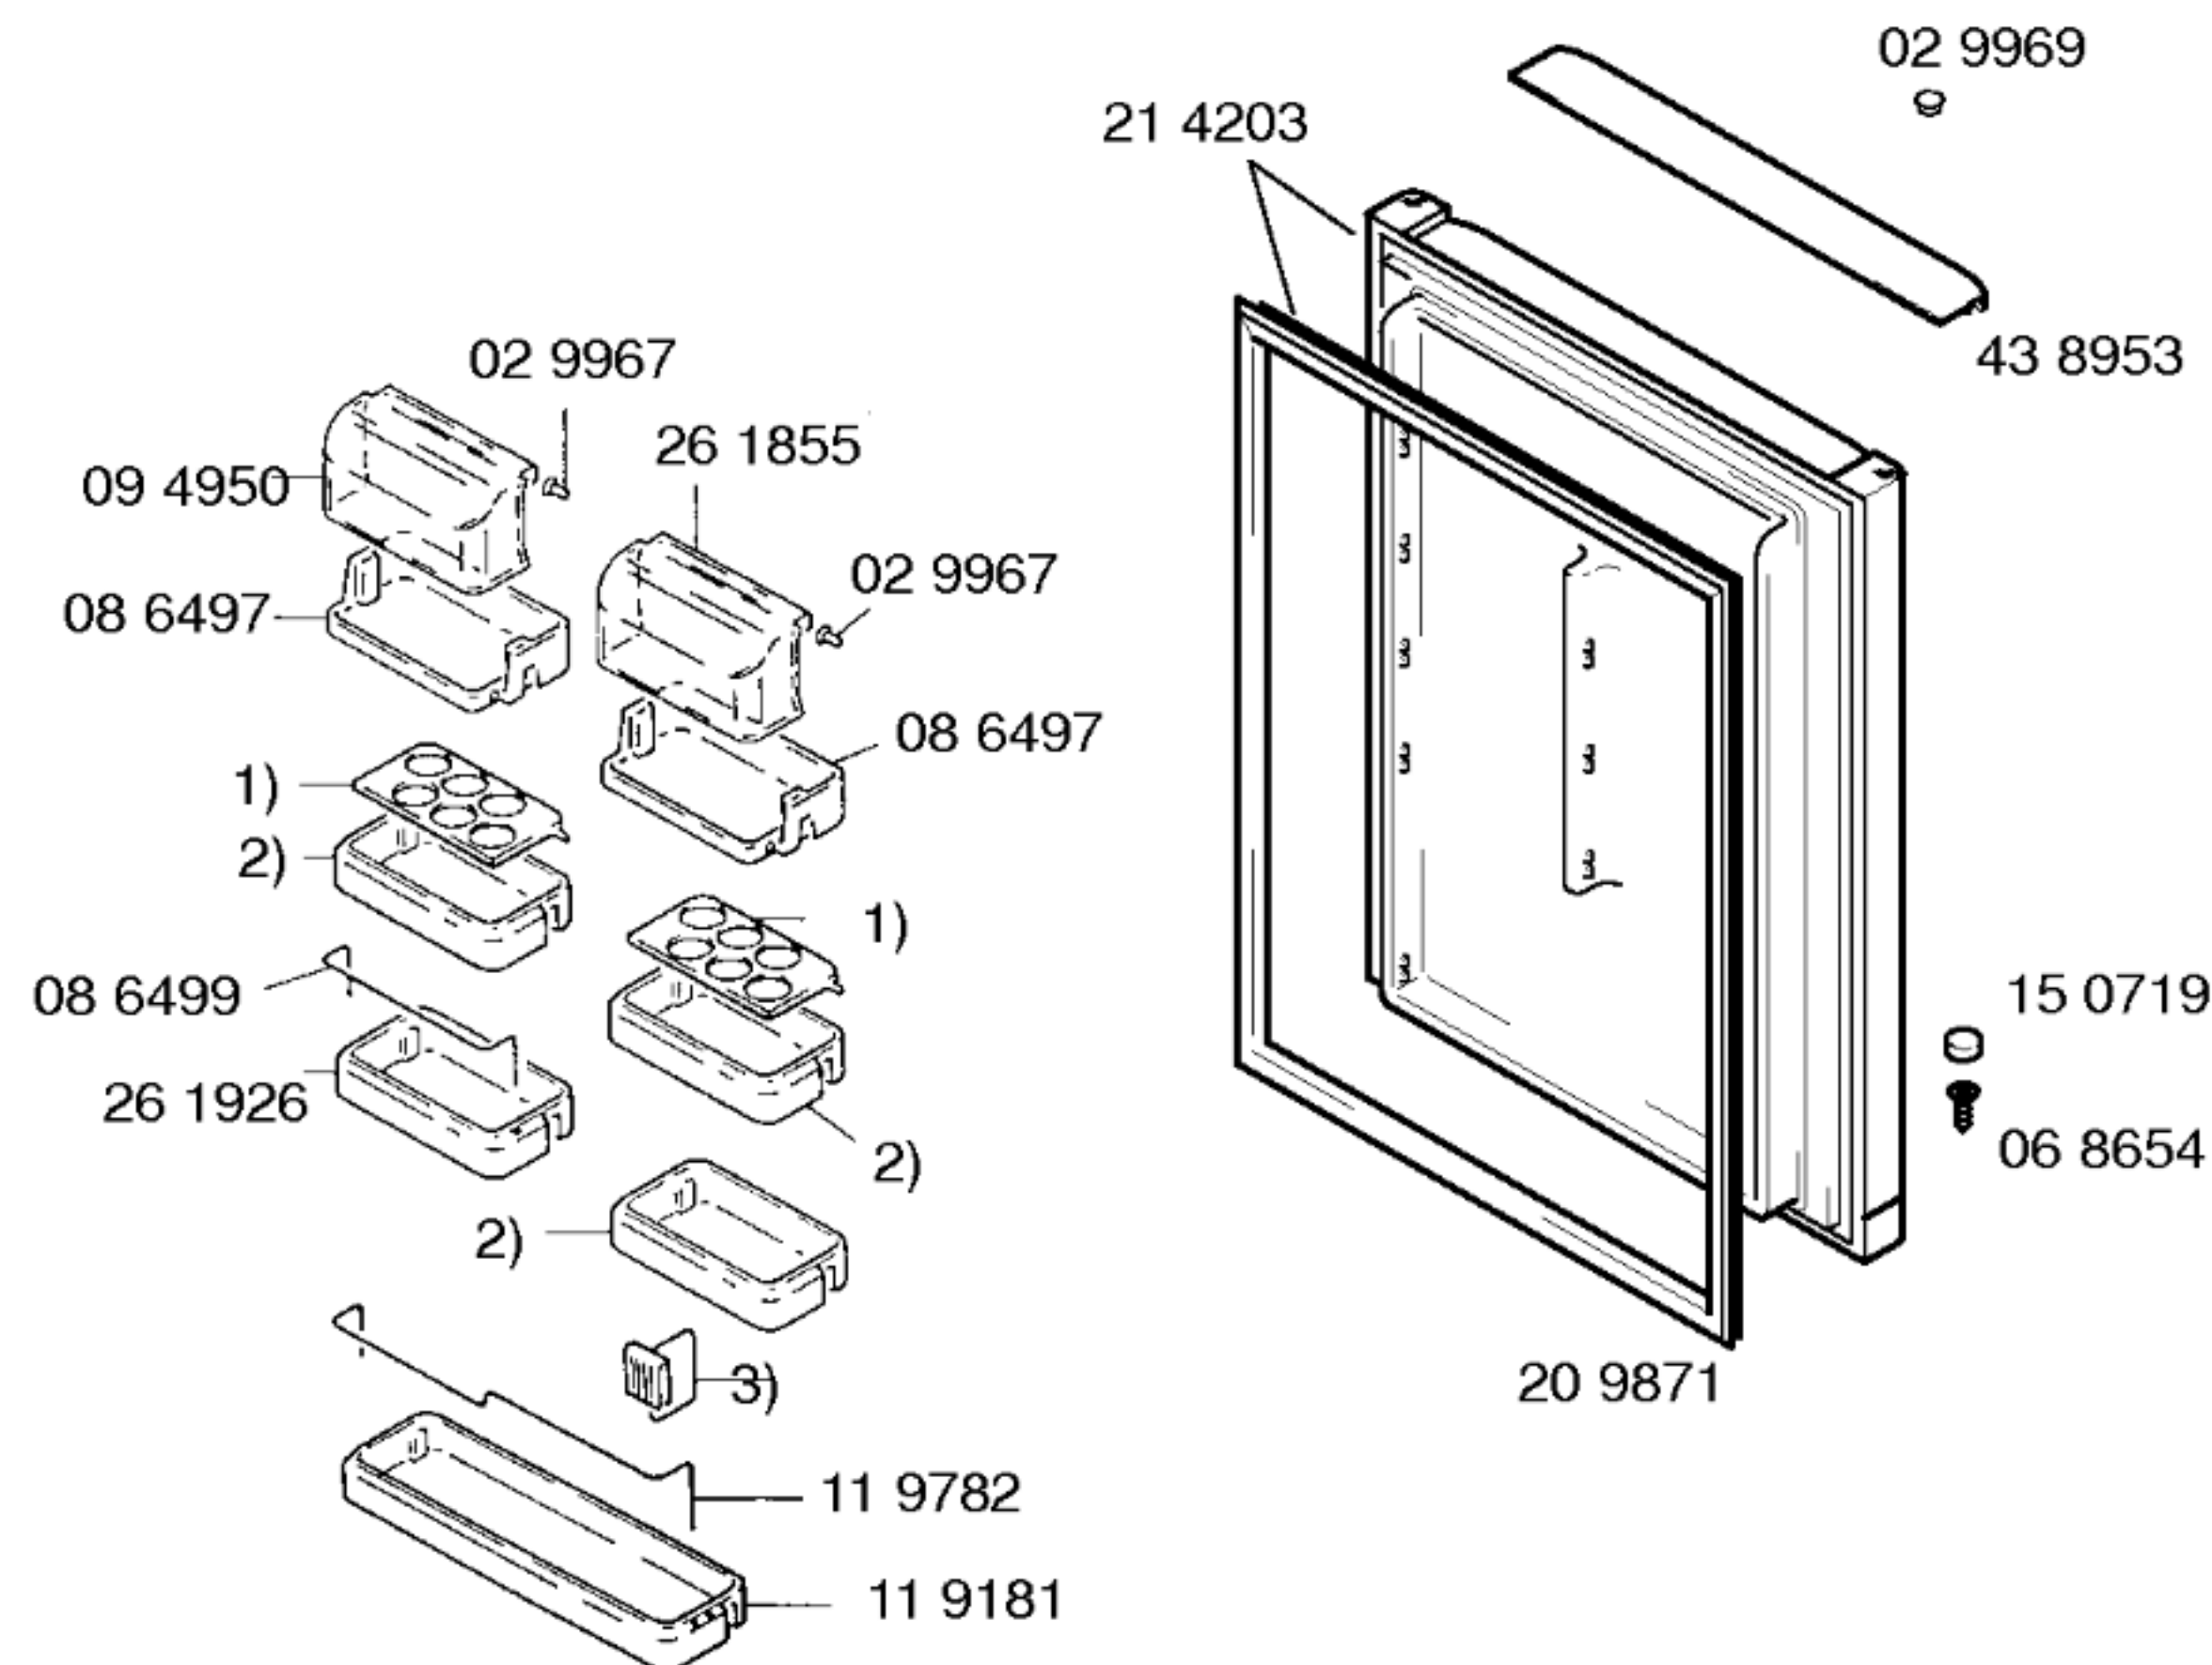


Ident – Nummern – Konstante
3740

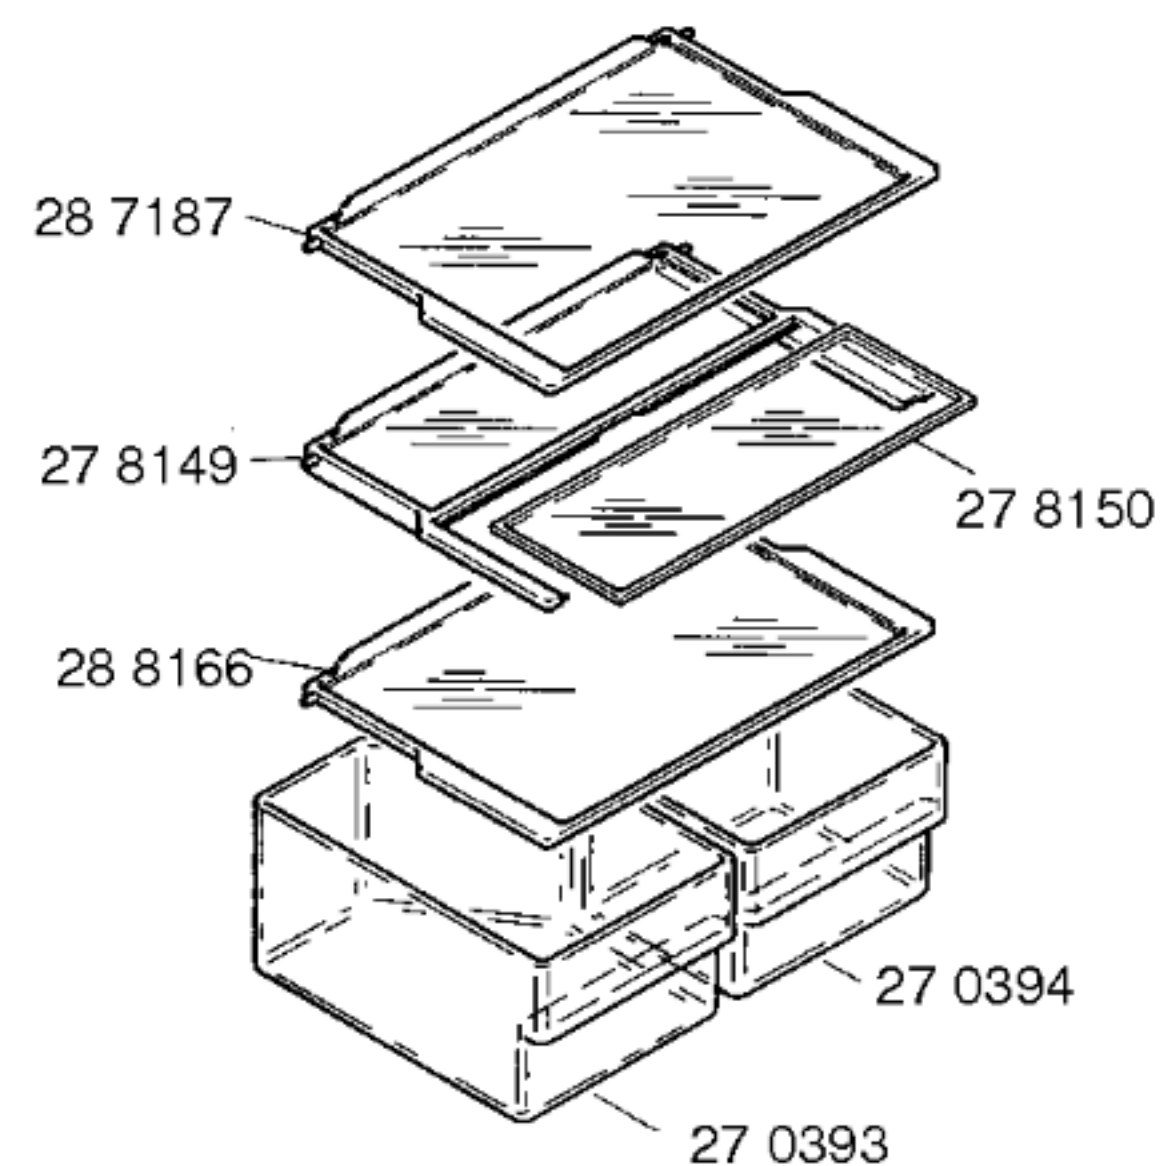

- 1) 26 7077
- 2) 08 6525
- 3) 17 3357

Ident – Nummern – Konstante
3740

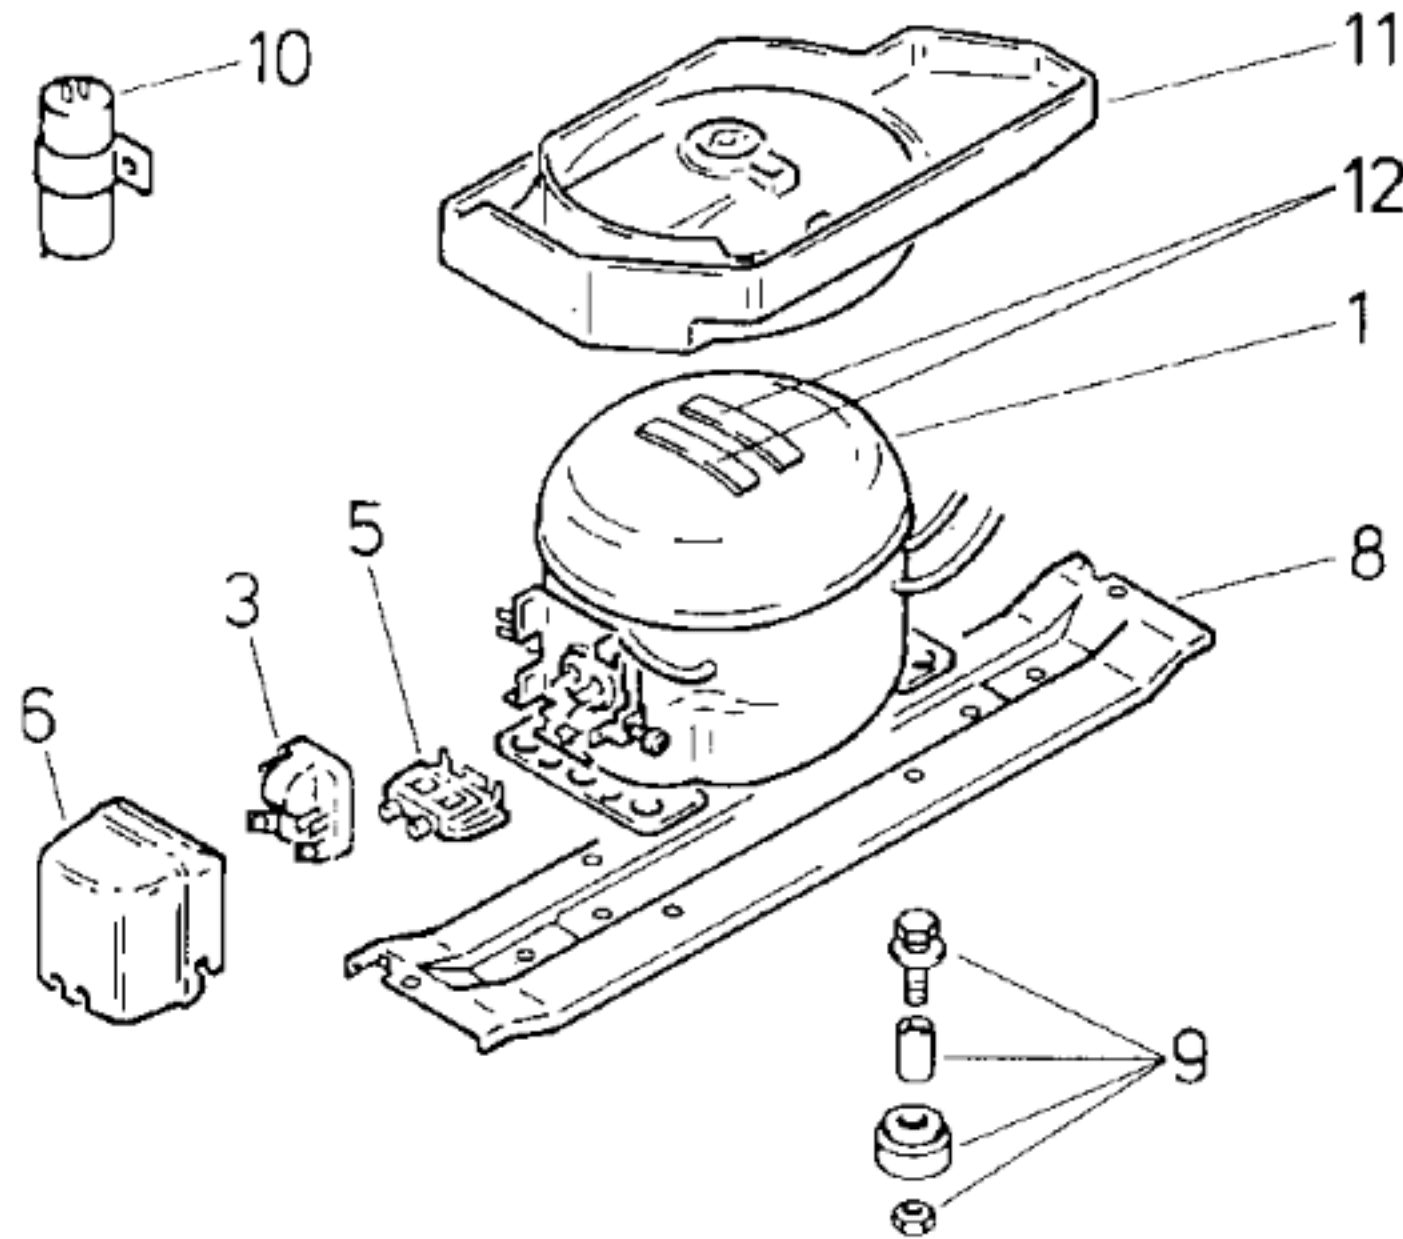

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES			
Verdichter/Compressor/Compresseur		Danfoss	Matsushita
Typ/Type		TLES 7 KK2	ESS 60E
Förderleistung/Delivery/Débit	l/h	1168	1076
Anlaufstrom/Starting current/Cour de démarrage	A	4,5	5,6
Widerstand/Resistance/Résistance	Ha/main/prin. Ω	18,9	30,6
	Hi/aux Ω	15,3	26,7
Temp. Regler/Thermostat			
Typ/Type			
Reglerstellung/Position			
Schaltwerte/Switching values/	„ein“ $^{\circ}\text{C}$		
Valeurs de commutation	„aus“		
(„abtauen“ od.)	„alarm“		
Füllmenge/Fill.quantity/Charge	R600a g	*	
Anschlußwert/Conn.load/Puiss. connectée	W	78	
Heizung/Heater/Chauffage			
Widerstand/Resistance/Résistance	Ω		
Leistung/Power/Puissance	W		
Ventilator/Blower/Ventilateur			
Widerstand/Resistance/Résistance	Ω		
Schaltuhr/Timer/Minuterie de contact			
Widerstand/Resistance/Résistance	Ω		
Magnetventil/Magnetic valve/Electrovanne			
Widerstand/Resistance/Résistance	Ω		
Spannung/Voltage/Tension	V		

* siehe Typenschild

Pos.	V01,V02	V03	
	Danfoss	Matsushita	
	TLES 7 KK2	ESS 60E	
1	14 1903	14 21 58	
2			
3	15 1055	18 3589	
4			
5	15 0760	18 3590	
6	15 1072	18 3591	
7			
8	27 1375	27 1375	
9	05 0166	05 0166	
10			
11	08 4744	08 4744	
12	05 6008	05 6008	